

HbA1c: Nessun dato


Microinf: Paradigm Veo - 554

#756280

Sensore: In uso

### Dati sensore (mg/dl)

04/03/10 ■ 05/03/10 ■ 06/03/10 ■ 07/03/10 ■ 08/03/10 ■ 09/03/10 ■ Media - - -

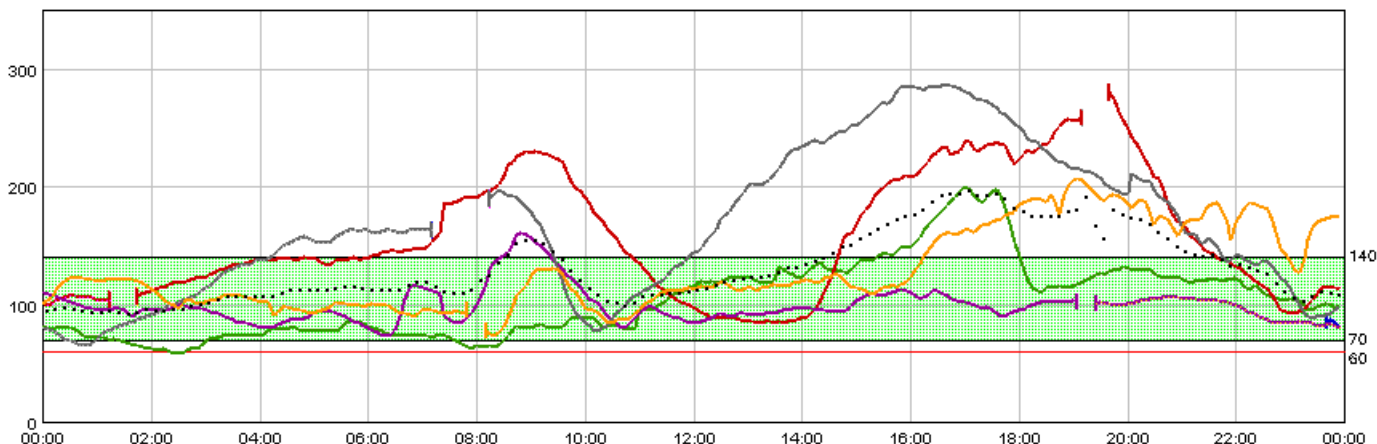


	gio 4 mar	ven 5 mar	sab 6 mar	dom 7 mar	lun 8 mar	mar 9 mar	Media/Totale
N° di valori sensore	4	288	278	285	276	285	1.416
Glic. sensore alta (mg/dl)	87	200	280	161	286	207	286
Glic. sensore bassa (mg/dl)	81	58	84	73	65	74	58
Glic. sensore media (mg/dl)	84	104	157	99	167	129	131
Dev. standard	N/A	33	52	15	63	34	50
% MAD	N/A	18,0	22,8	32,9	12,3	10,2	19,0
N° di calibrazioni valide	1	2	3	2	2	2	12

### Riepilogo escursioni

	gio 4 mar	ven 5 mar	sab 6 mar	dom 7 mar	lun 8 mar	mar 9 mar	Media/Totale
N° escursioni	0	2	2	1	2	1	8
N° escursioni GS alta	0	1	2	1	2	1	7
N° escursioni ipoglicemiche	0	1	0	0	0	0	1
AUC sopra limite	0,0	3,4	30,0	0,4	40,7	11,2	16,9
AUC sotto limite	0,0	0,7	0,0	0,0	0,1	0,0	0,1

### Durata distribuzione (hh:mm)



	04/03/10	05/03/10	06/03/10	07/03/10	08/03/10	09/03/10	Media/Totale
<b>Sopra 140</b>	0:00 0%	2:40 11%	11:25 49%	0:55 4%	14:15 62%	7:20 31%	36:35 31%
<b>Entro (70 - 140)</b>	0:20 100%	18:50 79%	11:45 51%	22:50 96%	8:15 36%	16:25 69%	78:25 66%
<b>Sotto 70</b>	0:00 0%	2:30 10%	0:00 0%	0:00 0%	0:30 2%	0:00 0%	3:00 3%