


HbA1c: Nessun dato

Microinf: Paradigm Veo - 554  
Sensore: In uso

#756980

### Dati sensore (mg/dl)

04/03/10 05/03/10 06/03/10 07/03/10 08/03/10 09/03/10 10/03/10 Media - - -

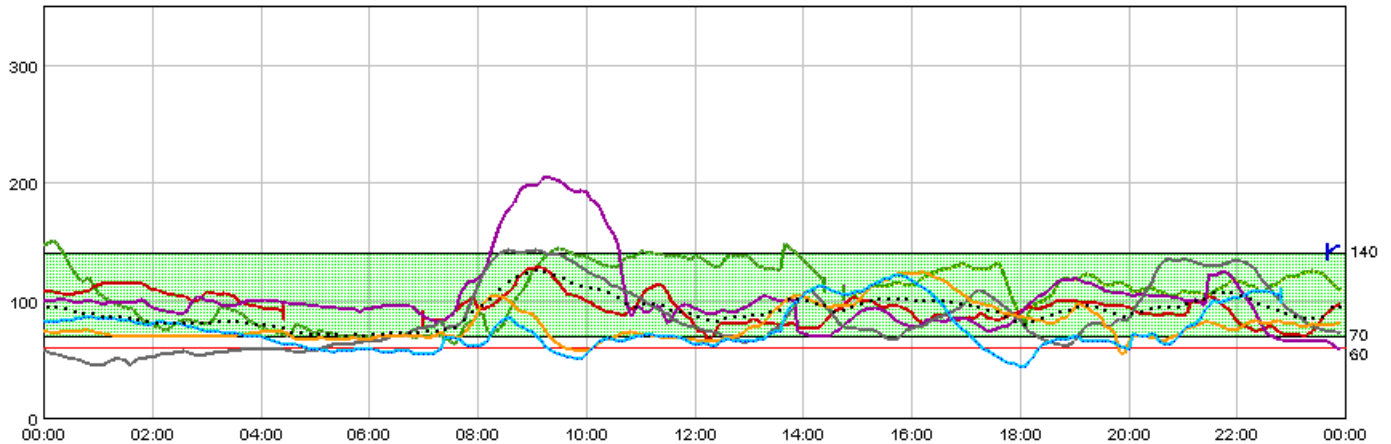

	gio 4 mar	ven 5 mar	sab 6 mar	dom 7 mar	lun 8 mar	mar 9 mar	mer 10 mar	Media/Totale
N° di valori sensore	4	285	258	288	288	288	275	1.686
Glic. sensore alta (mg/dl)	146	151	128	205	143	124	121	205
Glic. sensore bassa (mg/dl)	141	62	65	59	45	55	43	43
Glic. sensore media (mg/dl)	144	108	94	103	85	80	75	91
Dev. standard	N/A	24	13	31	28	15	18	26
% MAD	N/A	20,6	15,7	33,0	8,8	8,3	18,0	17,4
N° di calibrazioni valide	1	4	3	3	3	3	3	20

### Riepilogo escursioni

	gio 4 mar	ven 5 mar	sab 6 mar	dom 7 mar	lun 8 mar	mar 9 mar	mer 10 mar	Media/Totale
N° escursioni	1	3	0	2	1	2	4	13
N° escursioni GS alta	1	3	0	1	1	0	0	6
N° escursioni ipoglicemiche	0	0	0	1	0	2	4	7
AUC sopra limite	4,0	0,2	0,0	4,4	0,1	0,0	0,0	0,8
AUC sotto limite	0,0	0,1	0,0	0,3	4,1	1,0	4,4	1,7

### Durata distribuzione (hh:mm)



	0:20	100%	1:10	5%	0:00	0%	2:20	10%	0:35	2%	0:00	0%	0:00	0%	4:25	3%
<b>Sopra 140</b>	0:20	100%	1:10	5%	0:00	0%	2:20	10%	0:35	2%	0:00	0%	0:00	0%	4:25	3%
<b>Entro (70 - 140)</b>	0:00	0%	21:05	89%	21:20	99%	20:00	83%	15:05	63%	17:15	72%	11:25	50%	106:10	76%
<b>Sotto 70</b>	0:00	0%	1:30	6%	0:10	1%	1:40	7%	8:20	35%	6:45	28%	11:30	50%	29:55	21%